


BACKFILL IN PAVED AREAS SHALL BE  
CRUSHED STONE. SEE SPECIFICATIONS.

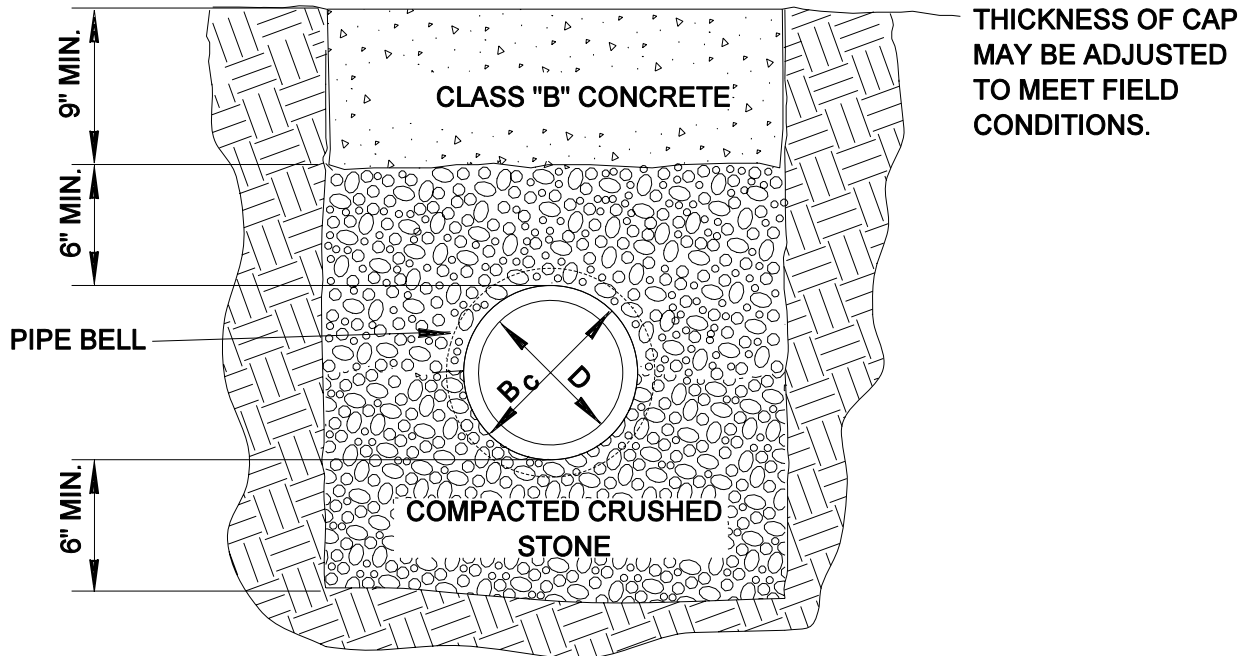

**NOTES:**

- 1) DETAILS ARE APPLICABLE TO  
BOTH EARTH & ROCK TRENCHES.
- 2) COMPACTED CRUSHED STONE  
SHALL BE SIZE NO. 67 AS  
GIVEN IN SECTION 903  
OF THE T.D.O.T. STANDARD  
SPECIFICATIONS FOR ROAD &  
BRIDGE CONSTRUCTION.

DRAWING NOT TO SCALE

**MAY 27. 1994**

DRAWN BY: M.H. & A.H.W.F.  
APPROVED BY: K.N.H.

## CONCRETE CAP

STANDARD  
DRAWING NO.

# S - 23

**MURFREESBORO WATER & SEWER DEPARTMENT**